


PLAN VIEW

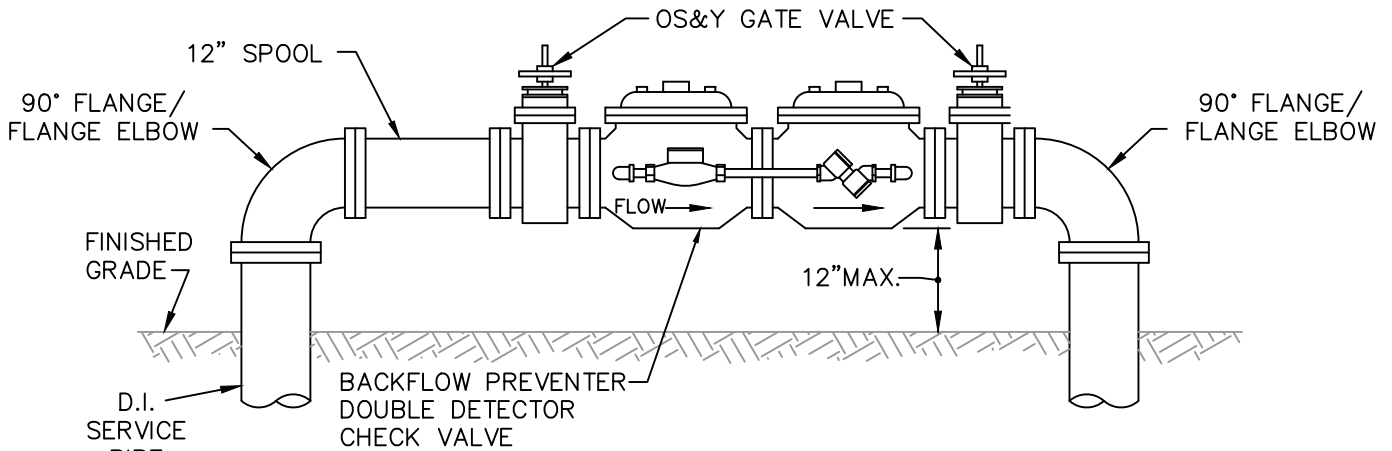


SECTION A-A

**DOUBLE CHECK VALVE
w/ DETECTOR CHECK ASSEMBLY / FIRE SERVICE**

NOTE:

LANDSCAPING IS REQUIRED PER CITY OR COUNTY ORDINANCE. PLANTINGS MUST SCREEN AT PLANT HEIGHT, NO GROW IN PERIOD.



STANDARD UTILITY DETAILS
City of Stuart
Utilities & Engineering Department
121 S.W. Flagler Avenue, Stuart, Florida 34994

BACKFLOW PREVENTION ASSEMBLY

DATE: OCTOBER 2021
FILE NAME: 2021 COS Std Details.dwg

SHEET NUMBER
34